




Granulats : Gravier Roulé Lavé 11.2/22.4
Péetrographie : Alluvionnaire
Elaboration : Roulé Lavé
Usage : Bétons hydrauliques

Classe granulaire		Partie contractuelle						Catégorie	
11.2	22.4	Norme NF P 18-545 Article 10						Code A	
		d/2	d	D	1.4D	2D	FI	W	
		0.063	5.6	11.2	22.4	31.5	45		
Etendue e			15	15					
V.S.S.+U		6	20	100			24.00		
V.S.S.	1.5	5	15	99			20.00		
V.S.I.			0	84	98	100			
V.S.I.-U			0	79	97				

Partie informative								
Résultats de production								
du 26/04/21 au 20/12/21								
	0.063	5.6	11.2	22.4	31.5	45	FI	W
Maximum	0.8	2	11	97	100	100	12.50	2.3
Moyenne Xf	0.3	1	5	93	100	100	7.75	1.5
Minimum	0.1	0	1	87	100	100	6.30	0.9
Ecart-type	0.14	0.4	2.3	2.8	0.0	0.0	2.399	0.30
Nombre de résultats	23	23	23	23	23	23	5	23

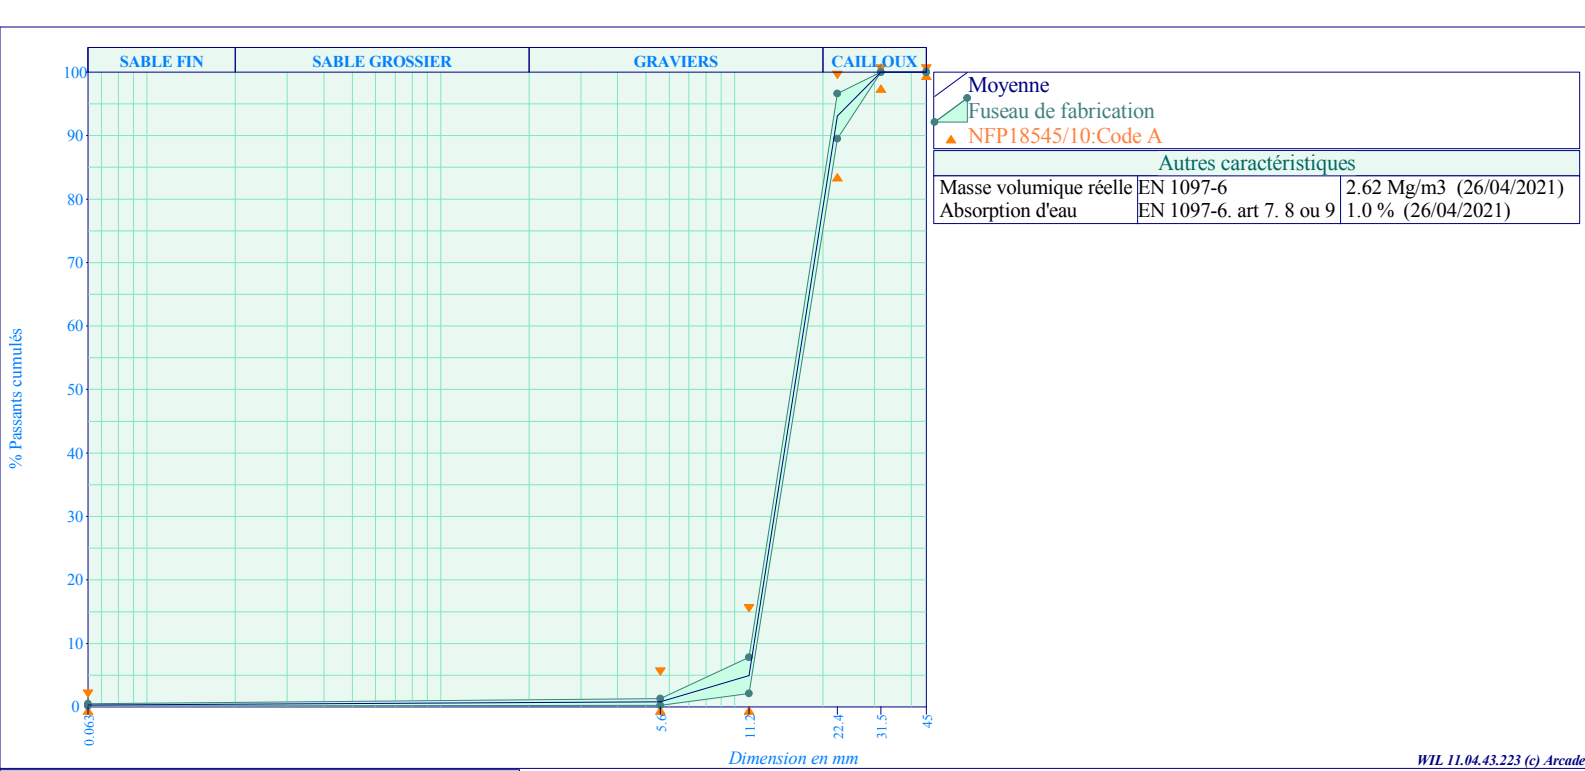

DRUET Marion Responsable QSE