




**Granulats :** GRAVILLON 12,50/20 ROULE LAVE  
**Péetrographie :** Silico-Calcaire  
**Elaboration :** Roulé Lavé  
**Usage :** Bétons hydrauliques

Classe granulaire		Partie contractuelle						Catégorie	
12.5 20		Norme NF P 18-545 Article 10						Code A	
		d/2	d	D	1.4D	2D			
		0.063	6.3	12.5	20	28	40	FI W	
Etendue e			15	15					
V.S.S.+U	1.8	6	20	100			24.00		
V.S.S.	1.5	5	15	99			20.00		
V.S.I.			0	84	98	100			
V.S.I.-U			0	79	97				

Partie informative								
Résultats de production								
du 26/04/21 au 20/12/21								
	0.063	6.3	12.5	20	28	40	FI	W
Maximum	0.4	1	15	97	100	100	10.70	2.5
Moyenne Xf	0.2	1	10	93	100	100	8.84	1.7
Minimum	0.0	0	4	87	100	100	7.30	0.6
Ecart-type	0.09	0.3	3.0	2.7	0.0	0.0	1.267	0.40
Nombre de résultats	22	22	22	22	22	22	5	22

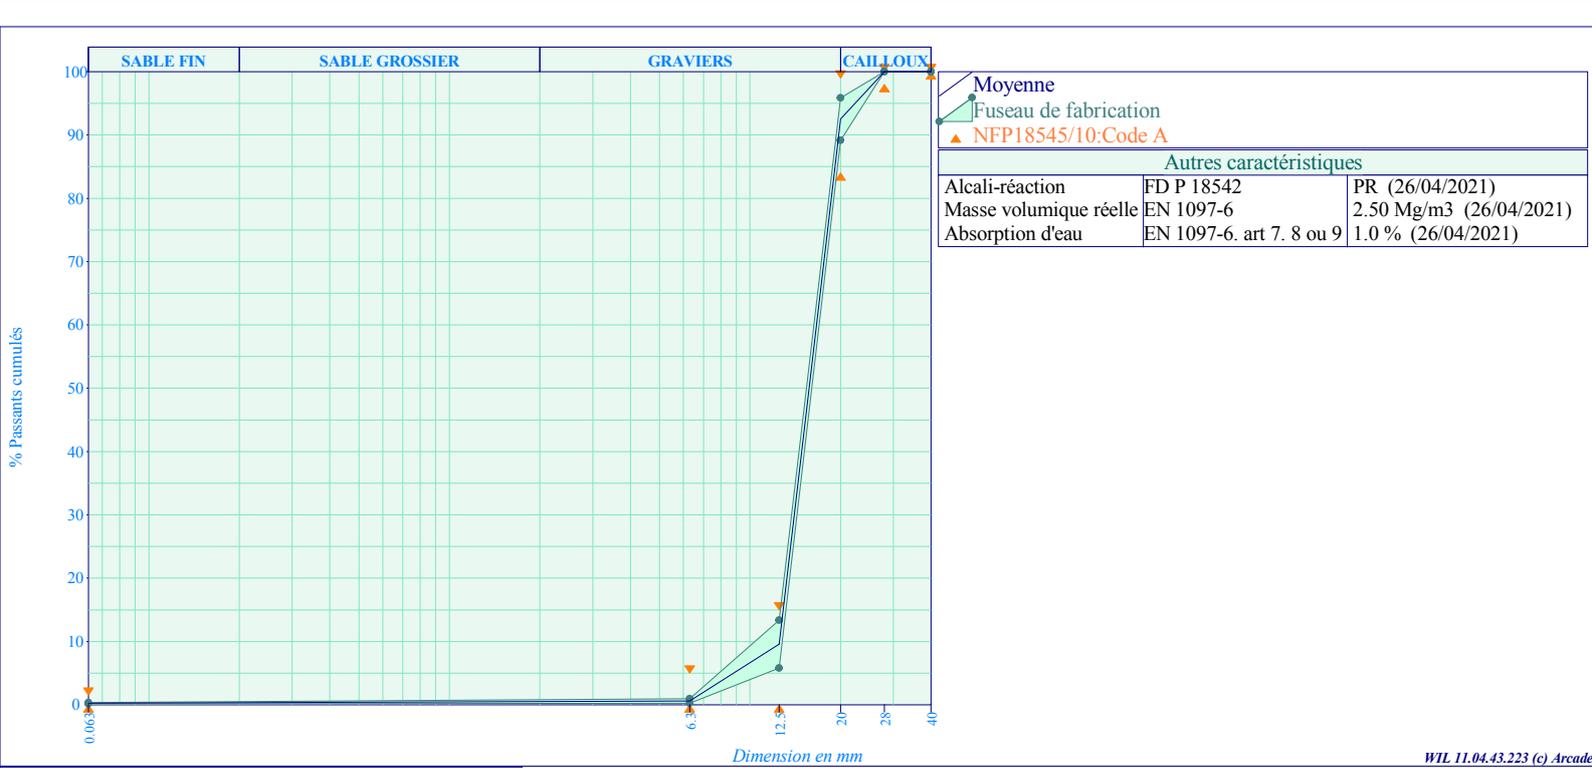

**DRUET Marion Responsable QSE**